


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

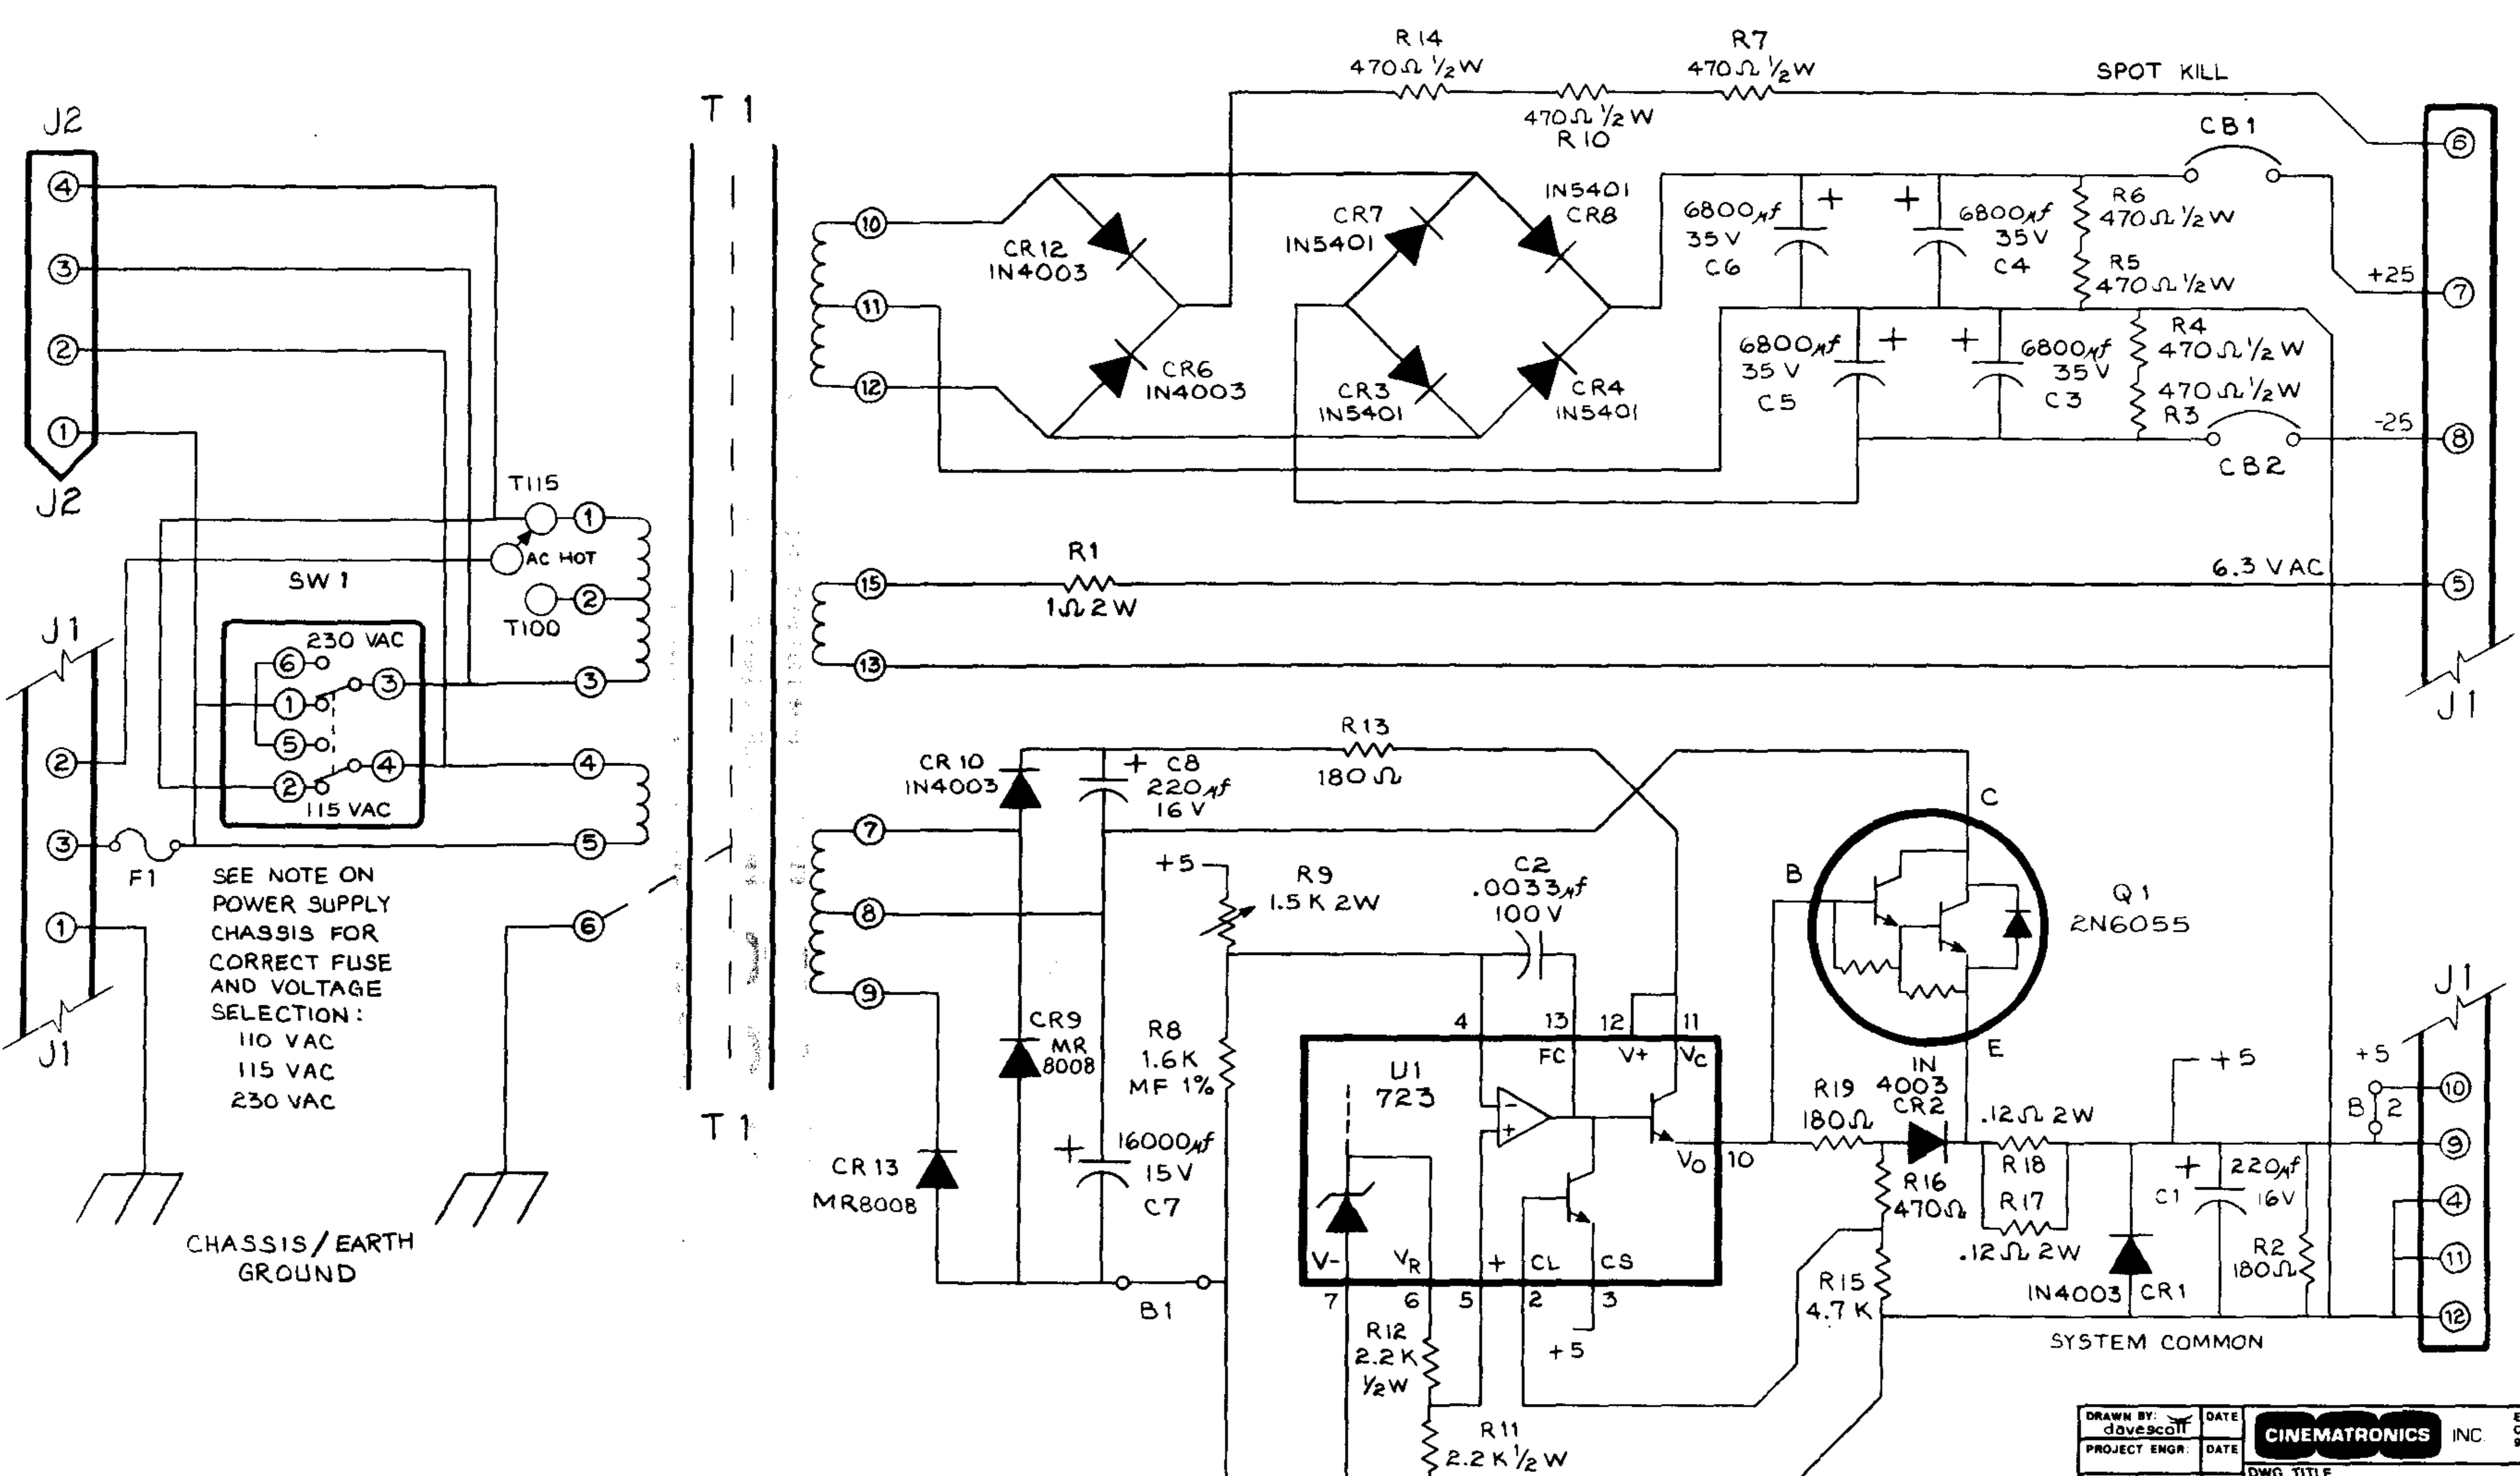

SEE NOTE ON POWER SUPPLY CHASSIS FOR CORRECT FUSE AND VOLTAGE SELECTION:  
 110 VAC  
 115 VAC  
 230 VAC

CHASSIS/EARTH GROUND

SCHEMATIC SET FOR 115 VAC OPERATION

NOTES: UNLESS OTHERWISE SPECIFIED

DRAWN BY: davescott	DATE	CINEMATRONICS INC. El Cajon Ca. 92020
PROJECT ENGR:	DATE	
RELEASE APPROV:	DATE	DWG TITLE
DO NOT SCALE DWG		CONDOR POWER SUP.
TOLERANCE: UNLESS OTHERWISE SPECIFIED	MODEL NO.	DWG NO. 72-10842-22
PROJECTION:	SCALE:	REV.
CODE IDENT.		SHEET / OF 1